

Minutes of site inspection followed by Pre-bid Meeting held on 13.07.2018 at 11.00 hours for the work for " Supply, Installation & Commissioning of Reefer Pillar Box along with allied electrical installation work"

Enquiry letter No. Mech/SE-I/25/218/1806 dt. 11.07.2018.

Present:

Kolkata Port Trust Officials

1. Sri A. Sanyal, Executive Engineer(Elect)
2. Sri N. Behera, Executive Engineer (Elect)


Firm Representatives


1. Sri B. N. Chattopaddhyay, - M/s. A. R. Rural Electricals,
2. Sri Arun Kr. Maji, - M/s. A. R. Rural Electricals
3. Sri Prabir Das, - M/s. Expert Electricals

The site was shown to the prospective bidders. The following clarifications relating to queries raised by the bidders are furnished below :-

1. Firms having relevant NISC / DIC Registration Certificate are exempted from submitting Earnest Money.
2. The dimension of 3.15 mm thick Pillar box shall be for both out side door & inside door and the Pillar Box shall be either Epoxy painted or Powder coated
3. The 400 A MCCB shall be of adjustable thermal and magnetic type with breaking capacity of 50 KA.
4. The L-1 firm shall be entitled to get Free Gate Pass facility while executing the work inside Dock premises.


All other terms and conditions of the enquiry remain unchanged. This minutes is to be considered as a part of the enquiry letter.


(A. Sanyal)
Exe. Engineer (Elect)

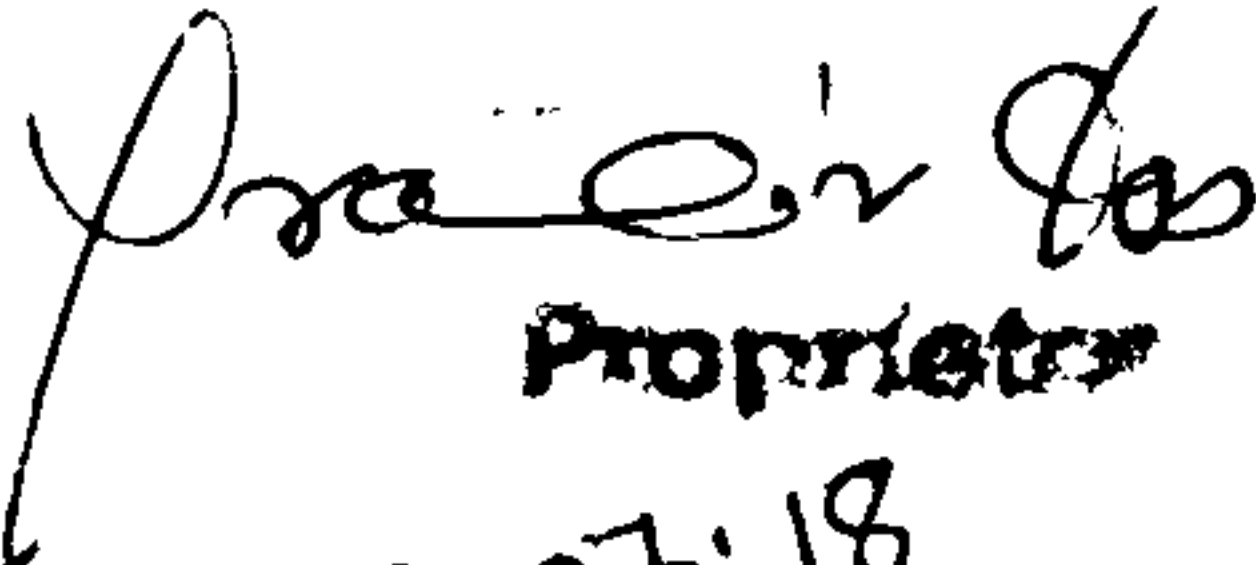

(N. Behera)
Exe. Engineer (Elect)

(Prabir Das)
M/s. Expert Electricals


(Arun Kr. Maji)
M/s. A.R.Rural Electricals


(B.N.Chattopadhyay)
M/s. A.R.Rural Electricals

EXPERT ELECTRICALS


Proprietor
13.07.18